

Purdue University
Purdue e-Pubs

International Refrigeration and Air Conditioning
Conference

School of Mechanical Engineering

2008

Experimental Study on the Heating Performance of a CO₂ Heat Pump with Gas Injection

Changhyun Baek
Korea University

Eungchan Lee
Korea University

Hoon Kang
Korea University

Yongchan Kim
Korea University

Follow this and additional works at: <http://docs.lib.purdue.edu/iracc>

Baek, Changhyun; Lee, Eungchan; Kang, Hoon; and Kim, Yongchan, "Experimental Study on the Heating Performance of a CO₂ Heat Pump with Gas Injection" (2008). *International Refrigeration and Air Conditioning Conference*. Paper 872.
<http://docs.lib.purdue.edu/iracc/872>

This document has been made available through Purdue e-Pubs, a service of the Purdue University Libraries. Please contact epubs@purdue.edu for additional information.

Complete proceedings may be acquired in print and on CD-ROM directly from the Ray W. Herrick Laboratories at <https://engineering.purdue.edu/Herrick/Events/orderlit.html>

Experimental Study on the Heating Performance of a CO₂ Heat Pump With Gas Injection

Changhyun Baek¹, Eungchan Lee², Hoon Kang³, Yongchan Kim^{1*}

¹Graduate School of Mechanical Engineering, Korea University
Anam-Dong, Sungbuk-Gu, Seoul, Korea
+82-2-9215946, bch2@korea.ac.kr

²Graduate School of Mechanical Engineering, Korea University
Anam-Dong, Sungbuk-Gu, Seoul, Korea
+82-2-9215946, eugene0274@korea.ac.kr

³Department of Mechanical Engineering, Korea University
Anam-Dong, Sungbuk-Gu, Seoul, Korea
+82-2-32904022, khlabkang@empal.com

^{1*}Department of Mechanical Engineering, Korea University
Anam-Dong, Sungbuk-Gu, Seoul, Korea
+82-2-32903366, yongckim@korea.ac.kr

ABSTRACT

With the increasing of the environmental concerns, carbon dioxide (CO₂) as an alternative refrigerant has been investigated intensively. In this study, the heating performance of a transcritical CO₂ heat pump system with a twin-rotary compressor was investigated. The transcritical CO₂ heat pump with gas injection was tested by varying gas injection ratio and outdoor temperature at the optimum refrigerant charge of 6400 g, compressor frequency of 40 Hz, and first and second EEV openings of 6% and 6%. The heating capacity ratio and COP ratio increased with the increase of the gas injection ratio at all outdoor temperatures due to the increase of the total mass flow rate. The heating performance of the transcritical CO₂ heat pump with gas injection was improved at low outdoor temperature. The heating capacity and COP ratio of the system with gas injection were improved by 45% and 24%, respectively, over the non-injection system at the outdoor temperature of -8 °C.

1. INTRODUCTION

Due to large expansion losses and irreversibility during the gas cooling process, the transcritical CO₂ system showed lower performance than conventional air-conditioning systems. Various studies have been conducted on the transcritical CO₂ cycle. Hwang and Radermacher [1999, 2000] studied a two-stage transcritical CO₂ cycle. Groll et al. [2002] studied the effect of the pressure ratios across compressors on the performance of a transcritical CO₂ cycle with two-stage compression and intercooling. Joseph and Pega [2005] developed transcritical CO₂ systems for small commercial applications. Kim [2002] studied the performance of an auto-cascade refrigeration system for a water heater using CO₂ as a working fluid.

In this study, the performance of a transcritical CO₂ heat pump with a twin-rotary compressor using gas injection was measured and analyzed. The gas injection technique was applied to increase heating capacity and improve compressor reliability at high pressure conditions. The heating performance of the transcritical CO₂ heat pump was measured by varying the gas injection ratio, refrigerant charge, compressor frequency, EEV opening, length of an internal heat exchanger, and outdoor temperature. In addition, a control algorithm to improve the heating performance of the transcritical CO₂ heat pump was developed.

2. EXPERIMENTAL SETUP AND TEST PROCEDURE

Figure 1 shows the schematic diagram of the experimental setup. The test setup consisted of a variable speed twin-rotary compressor, indoor unit, outdoor unit, flash tank, three different expansion valves, and mass flow meters. The twin-rotary compressor having two-stage cylinders in a compressor shell was driven by a BLDC motor. The outdoor unit consisted of a compressor and an outdoor coil (evaporator), and the indoor unit consisted of an indoor coil (gascooler) and an electronic expansion device (EEV). Gas refrigerant was injected from the flash tank to the inlet of the second-stage cylinder of the twin-rotary compressor by controlling an injection EEV. The injection ratio was defined as the ratio of the injected refrigerant mass flow rate to the total mass flow rate. The volume ratio of the second-stage cylinder to the first-stage cylinder in the twin-rotary compressor strongly affects intermediate pressure and compressor performance. The volume ratio of the twin-rotary compressor used in this study was 0.7. Fin tube heat exchangers were used as the gascooler and evaporator. Table 1 shows the specifications of the indoor and outdoor coils. The refrigerant flow rate was controlled by using the EEVs with an orifice diameter of 3 mm. An internal heat exchanger was installed in between the evaporator outlet and the gascooler inlet. Table 2 shows the uncertainties of the experimental parameters used in this study.

Table 3 shows test conditions used in the experiments. The heating performance of the transcritical CO₂ heat pump was measured by varying the refrigerant charge, injection EEV opening, and outdoor temperature. The optimum refrigerant charge was determined at the standard heating test condition: indoor test conditions of 20 °C DB and 15 °C WB, and outdoor test conditions of 7 °C DB and 6 °C WB.

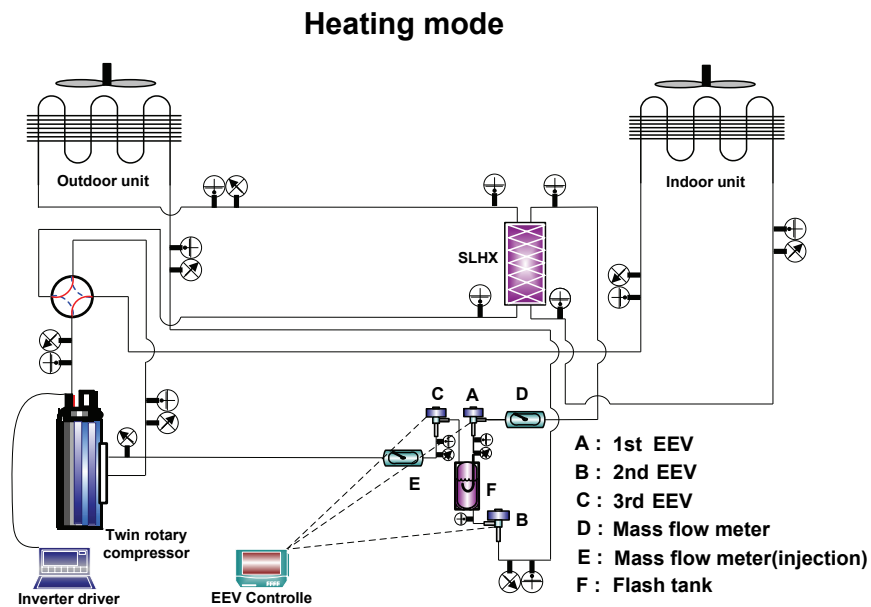


Figure 1 : Schematic diagram of the transcritical CO₂ heat pump.

Table 1 : Specifications of indoor and outdoor coils

	Indoor coil	Outdoor coil
Row x Step x Circuits	3 x 52 x 4	3 x 32 x 8
Diameter (mm)	7	7
Fin pitch (mm)	1.2	1.8
Fin type	Louvered fin	Louvered fin

Table 2 : Experimental uncertainties

Parameters	Uncertainties
Temperature (T-type) (°C)	±0.1 °C
Pressure(bar)	±0.2% of full scale
Mass flow rate(kg/h)	±0.2% of reading
Power input (kW)	±0.01% of full scale
Heating capacity(kW)	±3.71%
COP	±3.73%

Table 3 : Test conditions

Parameters	Specifications
1st/ 2nd EEV opening (%)	6/ 6
Injection EEV opening (%)	0, 8, 10, 12, 14
Compressor frequency (Hz)	40
Operating conditions (°C, DB/WB)	Indoor = 20/15 Outdoor = 7/6, 2, -3, -8

3. RESULTS AND DISCUSSION

In this study, the performance of the transcritical CO₂ heat pump with gas injection was tested by varying gas injection ratio, EEV opening, and outdoor temperature at the optimum refrigerant charge of 6400 g, compressor frequency of 40 Hz, and first and second EEV openings of 6% and 6%.

Figure 2 shows the variation of mass flow rate with injection ratio. Total and injection mass flow rate increased with the increase of injection ratio at all outdoor temperatures due to the increase of the refrigerant density at the second-stage cylinder inlet in the twin-rotary compressor with intercooling effects by using the injected refrigerant.

Figure 3 shows the variation of total mass flow rate ratio with injection ratio. The total mass flow rate ratio was defined as the ratio of increased total mass rate with gas injection to total mass rate without gas injection. The total mass flow rate ratio increased with the increase of injection ratio due to the increase of the refrigerant mass flow at the second-stage cylinder inlet in the twin-rotary compressor with the increase of injection ratio. The total mass flow rate ratio at the same injection ratio increased with the decrease of the outdoor temperature, because the pressure difference between the injection EEV outlet and the first-stage cylinder outlet in the twin-rotary compressor increased with the decrease of the compressor intermediate pressure and refrigerant density.

Figure 4 shows the variation of compressor discharge temperature with injection ratio. The discharge temperature decreased with the increase of injection ratio at all outdoor temperatures because the refrigerant temperature at the second-stage cylinder inlet in the twin-rotary compressor was decreased by applying gas injection. So, a lower discharge temperature in the twin-rotary compressor increased reliability of the system.

Figure 5 shows the variation of compressor work with injection ratio. The compressor work increased with the increase of injection ratio at all outdoor temperatures because the increase in the total mass flow rate ratio was relatively higher than the decrease in the compressor discharge temperature.

Figure 6 shows the variation of heating capacity ratio with injection ratio. As the outdoor temperature decreased from 7 °C to -8 °C, the increasing slope of the heating capacity ratio increased with the increase of injection ratio due to the increase in the total mass flow rate ratio. The heating capacity ratios at the outdoor temperatures of -8 °C and 7 °C increased by 45% and 11% with the increase of injection ratio from 0 to 0.27, respectively.

Figure 7 shows the variation of COP with injection ratio. The COP ratio of the transcritical CO₂ heat pump increased with the decrease of the outdoor temperature at all injection ratios. The COP ratio at outdoor temperatures below 2 °C increased with the increase of injection ratio because the increase of the heating capacity ratio was higher than the increase of the compressor work. However, the COP ratio at the outdoor temperature of 7 °C decreased with the increase of injection ratio because the increase of the compressor work was higher than the increase of the heating capacity ratio. The COP ratio for the outdoor temperature of -8 °C increased by 24% with the increase of injection ratio from 0 to 0.27. However, it for the outdoor temperature of 7 °C decreased by 9% with the increase of injection ratio from 0 to 0.27.

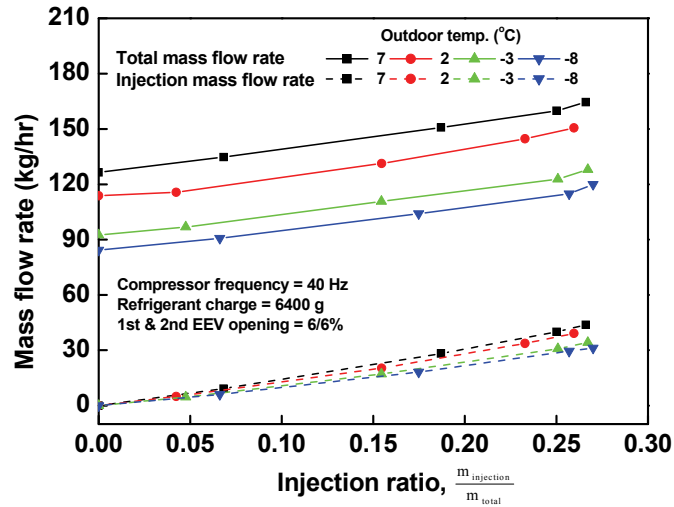


Figure 2 : Variation of mass flow rate with injection ratio.

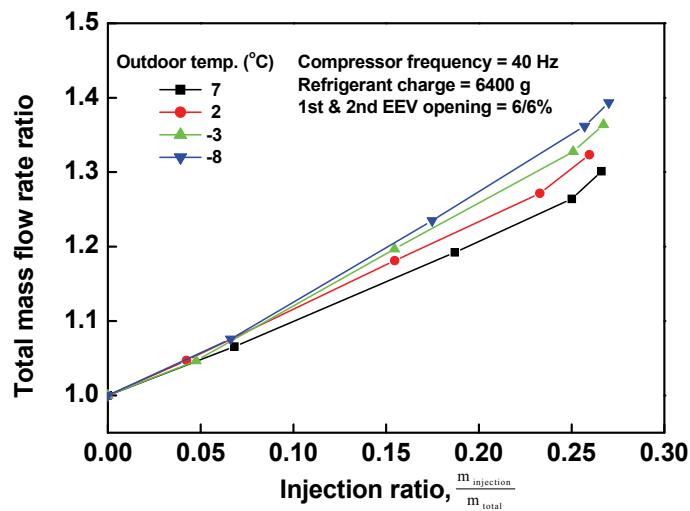


Figure 3 : Variation of total mass flow rate ratio with injection ratio.

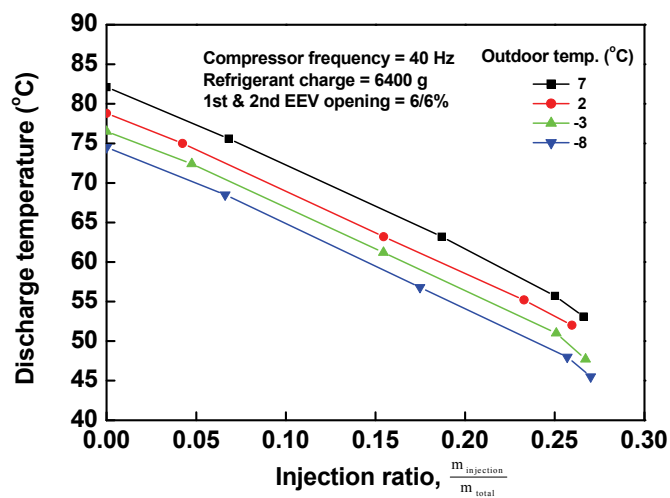


Figure 4 : Variation of discharge temperature with injection ratio.

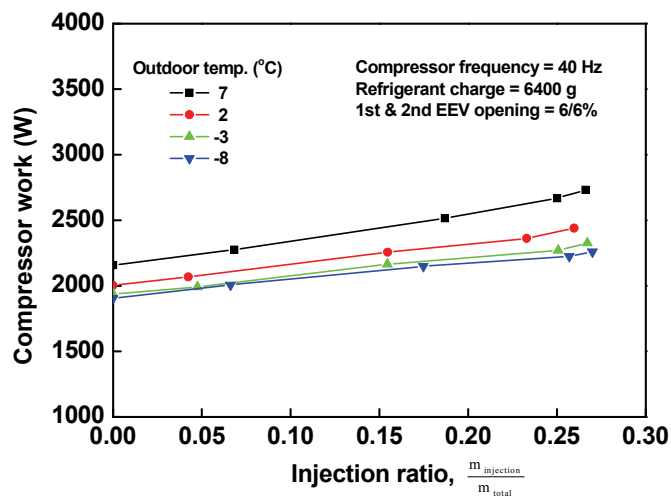


Figure 5 : Variation of compressor work with injection ratio.

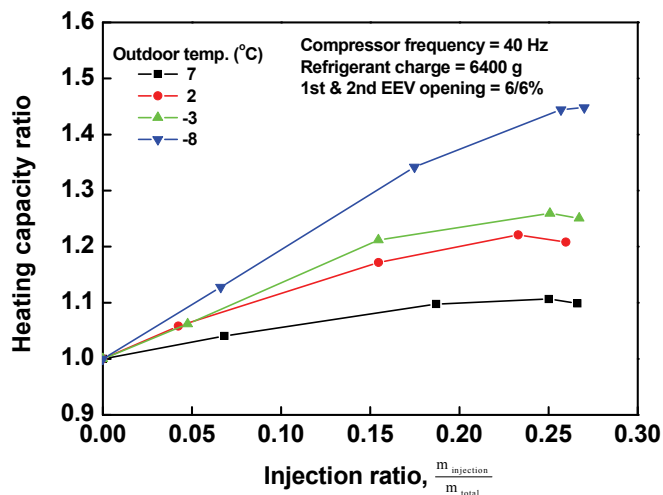


Figure 6 : Variation of heating capacity ratio with injection ratio.

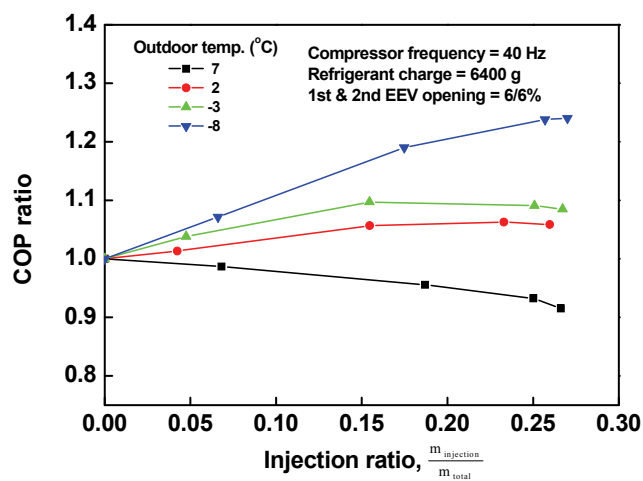


Figure 7 : Variation of COP ratio with injection ratio.

Figure 8 shows the variation of total mass flow rate ratio with outdoor temperature. The total mass flow rate ratio decreased with the decrease of the outdoor temperature at all injection EEV openings. The decreasing slope of the total mass flow rate ratio decreased with the increase of the injection EEV opening because the injected refrigerant flow rate increased with the increase of the injection EEV opening.

Figure 9 shows the variation of heating capacity ratio with outdoor temperature. The heating capacity ratio decreased with the decrease of the outdoor temperature at all injection EEV openings due to the decrease of the compressor discharge temperature and total mass flow rate. The decreasing slope of the heating capacity ratio decreased due to the increase of the heating capacity with the increase of the injection EEV opening.

Figure 10 shows the variation of COP ratio with outdoor temperature. The COP ratio of the transcritical CO₂ heat pump with gas injection decreased with the decrease of the outdoor temperature at all injection EEV openings. However, as the injection EEV opening increased, the decreasing slope of the COP ratio was reduced due to the increase of the heating capacity.

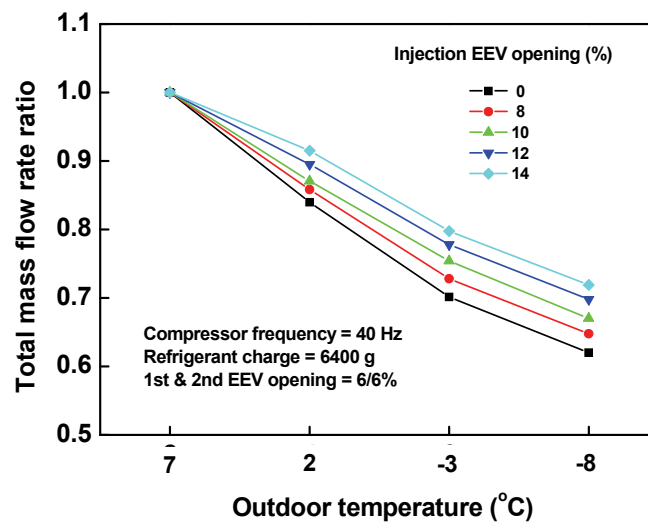


Figure 8 : Variation of total mass flow rate ratio with outdoor temperature.

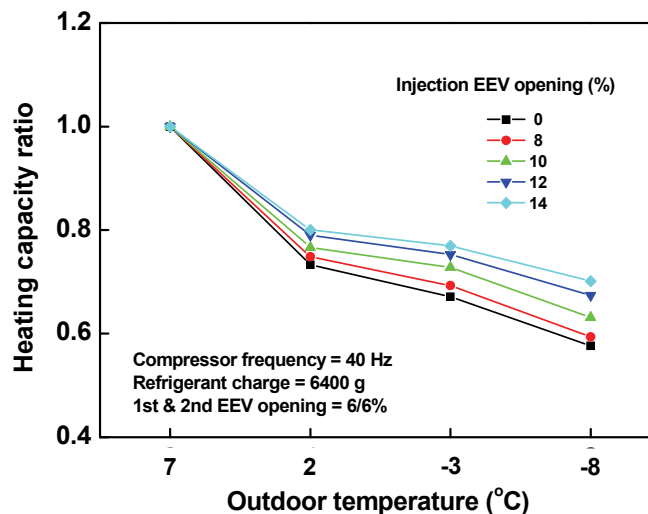


Figure 9 : Variation of heating capacity ratio with outdoor temperature.

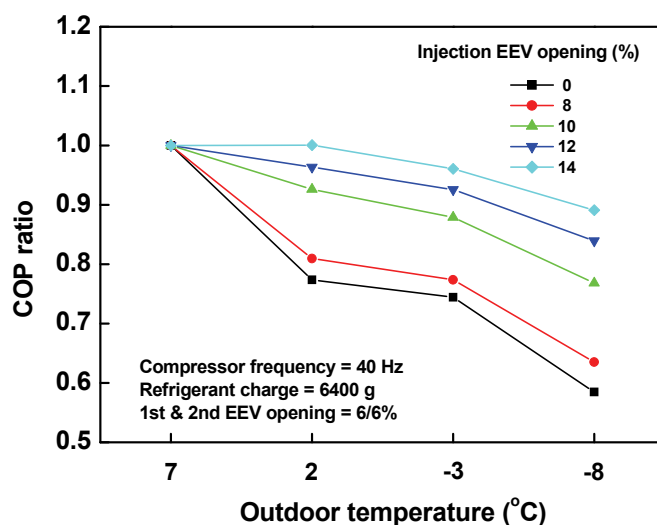


Figure 10 : Variation of COP ratio with outdoor temperature.

4. CONCLUSIONS

A transcritical CO₂ heat pump with gas injection was tested by varying the gas injection ratio and outdoor temperature. Based on the preliminary tests, the optimum refrigerant charge of the CO₂ system was 6400 g. The volume ratio of the variable speed twin-rotary compressor was 0.7. The heating capacity ratio and COP ratio increased with the increase of injection ratio due to the increase in the total mass flow rate. The heating capacity ratio and COP ratio at the same injection ratio increased with the decrease of the outdoor temperature due to the increase in the total mass flow rate ratio at low outdoor temperatures. The heating capacity ratios at the outdoor temperatures of -8 °C and 7 °C increased by 45% and 11%, respectively. The COP ratio at the outdoor temperatures of -8 °C and 7 °C increased 24% and -9%, respectively. Therefore, the transcritical CO₂ heat pump with gas injection showed better performance at low outdoor temperatures than that at normal operating conditions.

NOMENCLATURE

<i>COP</i>	coefficient of performance
<i>EEV</i>	electronic expansion valve
<i>Temp</i>	temperature
<i>WB</i>	wet bulb
<i>DB</i>	dry bulb

REFERENCES

- Lorentzen, G., Pettersen, J., 1993, A new, environmentally benign system for car air-conditioning, *Int. Journal of Refrigeration*, Vol. 16, No.1: pp. 4-12.
- Neksa, P., Rekstad, H., Zakeri, R., Schiefloe, P., 1998, CO₂-heat pump water heater: characteristics, system design and experimental results, *Int. Journal of Refrigeration*, Vol. 21, No. 3: pp. 172-179.
- Hwang, Y., Radermacher, R., 1999, Experimental investigation of the CO₂ refrigeration cycle, *ASHRAE Transactions*, Vol. 105, Pt. 1: pp. 1219-1227.

- Hwang, Y., Radermacher, R., 2002, Options for a two-stage transcritical carbon dioxide cycle, 5th IIR-Gustav Lorentzen Natural Working Fluids Conference at Guangzhou: pp. 143-149.
- Hanfner, A., 2000, Experimental study on heat pump operation of prototype CO₂ mobile air conditioning system, 4th IIR-Gustav Lorentzen Conference: pp. 177-184.
- Joseph, D., Pega, S., 2005, Development of transcritical R744 systems for small commercial applications, IIR Vicenza Conference, pp. 167-178.
- Groll, E., Baek, J. and Lawless, P., 2002, Effect of pressure ratios across compressors on the performance of the transcritical CO₂ cycle with two-stage compression and intercooling, Compressor Engineering Conference at Purdue, R11-7.
- Cho, H., Lee, h., Kim, y., 2006, Experimental study on the cooling performance improve ment of a two-stage compression CO₂ cycle, *Korean Journal of Air-conditioning and Refrigeration*, Vol. 18, No.10, pp.835-841.
- Cho, H., Ryu, C., Kim, Y., Kim H. Y., 2005, Effects of refrigerant charge amount on the performance of a transcritical CO₂ heat pump, *Int. Journal of Refrigeration*, Vol. 28: pp. 1266-1273.
- S. Kim, M. Kim, Experiment and simulation on the performance of an autocascade refrigeration system using carbon dioxide as a refrigerant, *Int. Journal of Refrigeration*, Vol. 25, No. 8 : pp. 1093-1101.

ACKNOWLEDGEMENT

This work was supported by Ministry of Knowledge Economy (Grant No. : 00014860-2007-31).

MANUSCRIPT REFERENCE NO. 2250

**19th International Compressor Engineering Conference at
Purdue**
**12th International Refrigeration and Air Conditioning
Conference at Purdue**
July 14-17, 2008

Agreement for Permission to Publish

The manuscript cited below has been accepted for presentation at the Conferences and for publication in the proceedings and the CD-ROM of the 19th International Compressor Engineering Conference at Purdue or the 12th International Refrigeration and Air Conditioning Conference at Purdue. The undersigned is (are) the author(s) of this manuscript and assign(s) to Purdue University the right to publish this manuscript in the proceedings and the CD-ROM of the Conferences and the rights to Purdue University and to sponsoring and cooperating organizations to reprint and to offer in whole or in part for reproduction or translation and for abstracting and indexing. Purdue University gives the author(s) permission to publish material from this manuscript in other publications but would request that they reference the Purdue Conferences.

It is understood that the sponsoring and cooperating organizations, by accepting this manuscript, do not accept responsibility for the accuracy or technical validity of the manuscript, or for it containing proprietary information or matter libelous or otherwise unlawful, or which invades individual privacy. It is further understood that the author(s) has (have) not included matter in the manuscript libelous or otherwise unlawful, or which invades individual privacy or which violates copyright laws or is subject to dispute.

Title of Manuscript:

Experimental study on the heating performance of a CO₂ heat pump with gas injection

If the authors are not in the same location, have each author sign and date the form and send all signed copies of the form to the address below:


Signature of author(s)

Changhyun Baek




2008. 4. 30

Eungchan Lee



2008. 4. 30

Hoon Kang



2008. 4. 30

Yongchan Kim



2008. 4. 30

Please return completed form with your manuscript to:

Mrs. Virginia (Ginny) Freeman, Technical Program Secretariat

Purdue University, Ray W. Herrick Laboratories

140 S. Martin Jischke Drive, West Lafayette, IN 47907, USA

Telephone: 765/494-6078 or Fax: 765/494-0787; E-Mail: herlconf@ecn.purdue.edu

